


- 440 x 215 x 100 Roadstone Standard Blocks
- 440 x 215 x 100 Roadstone Thermal Liteblock
- Partial fill Cavity Wall
- U-Values vary, see appendix D of TGD part L 2011.

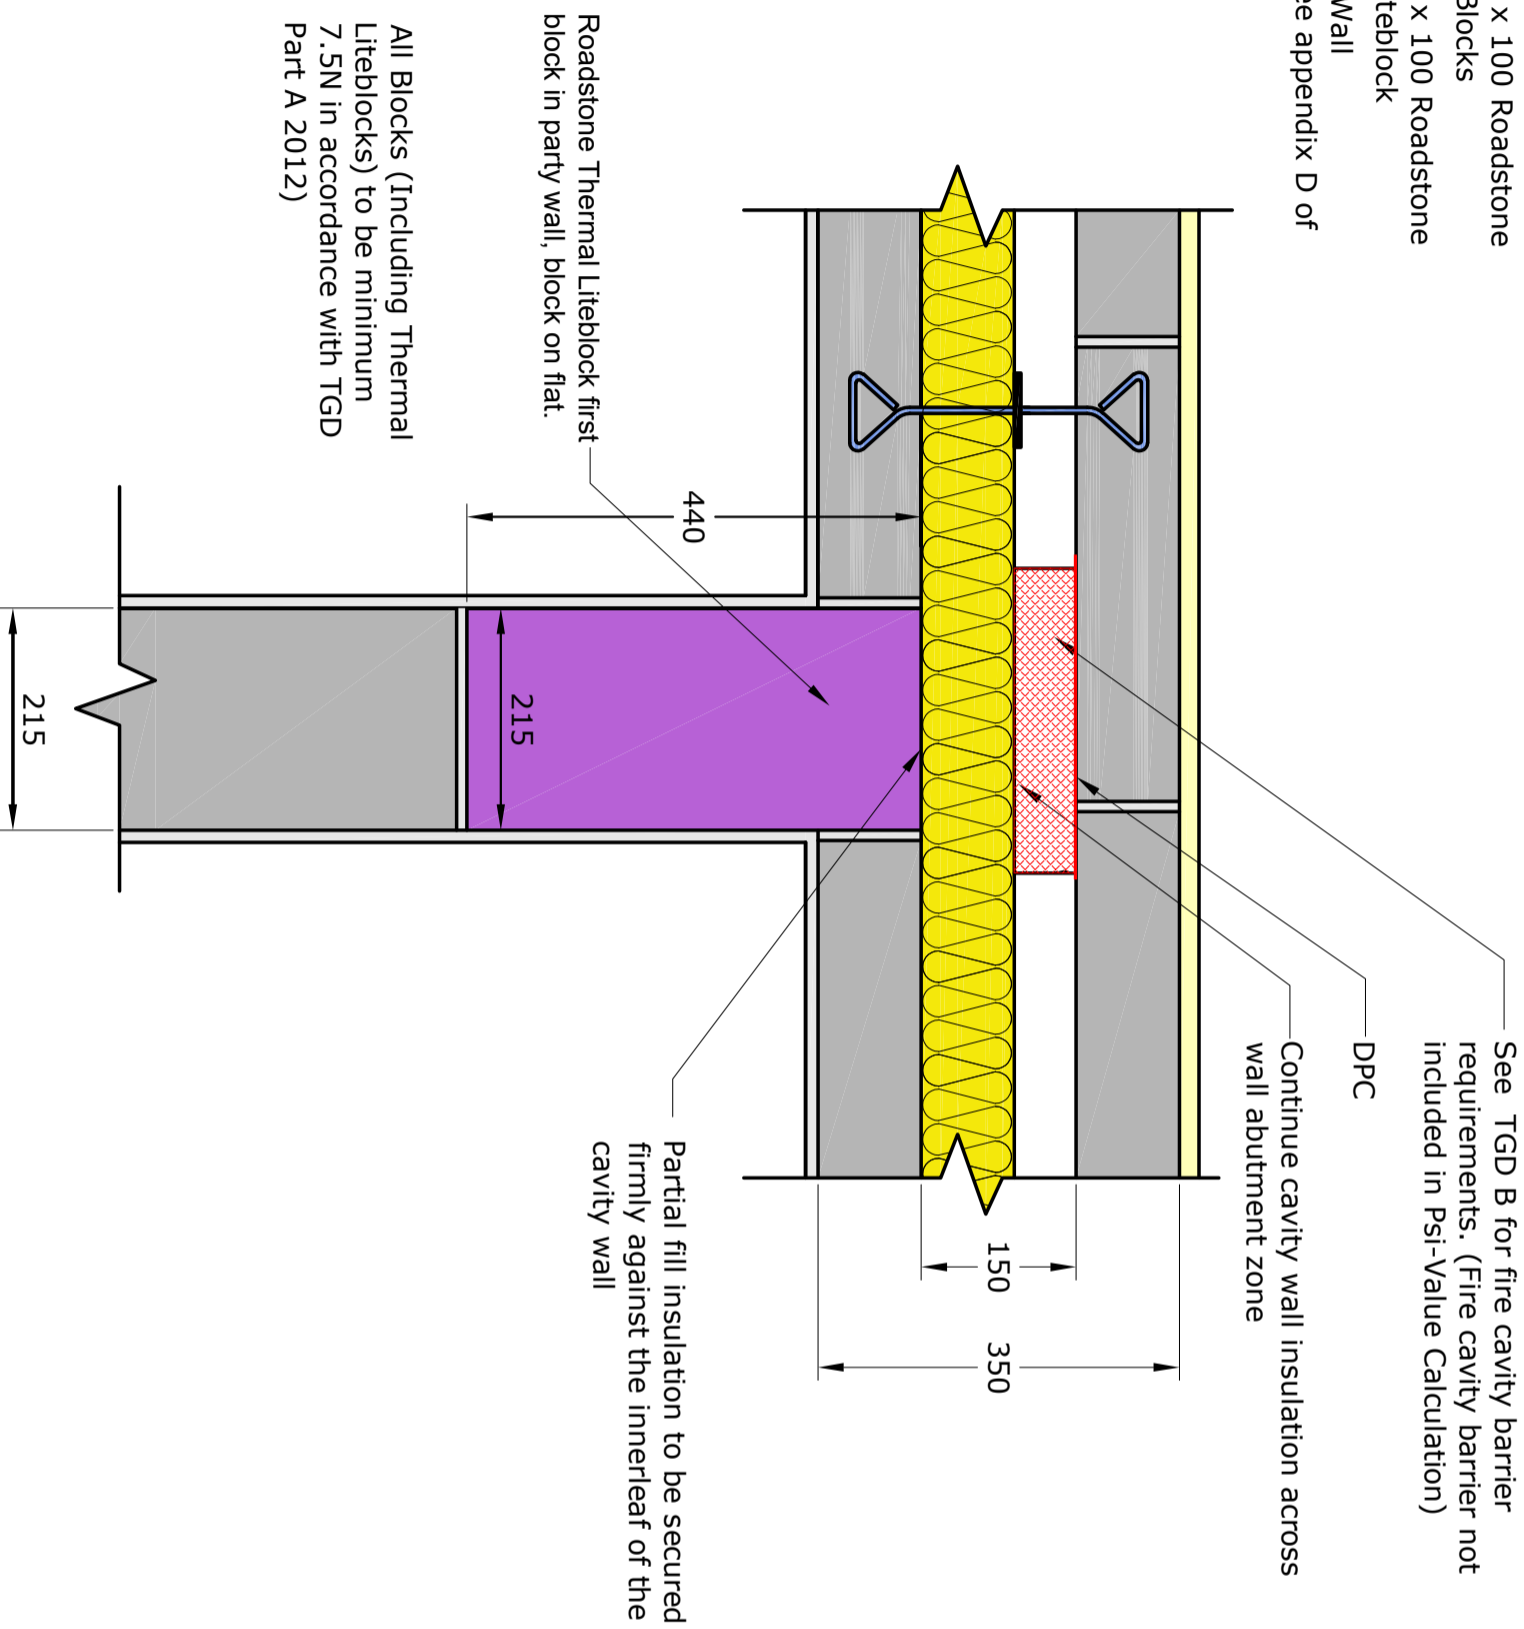

The diagrams, drawings and details included in this brochure are for indicative purposes only. They do not constitute nor should they be relied upon as giving/providing any design detail. They focus on the issues of thermal performance only. Insulation thicknesses of the main building elements have not been provided, as these are dependent on the thermal properties of the materials chosen, as well as on the desired U value. These diagrams, drawings and details illustrate good practice for the design and construction of interfaces solely in connection with thermal performance. The product should be used with due regard to all other requirements imposed by the Building Regulations and advices should be sought from a design professional in connection with the use of this product where required.

REVISION: A

DWG. NO.: DETAIL RS 1.06.1

DATE: March 2018

SCALE: NTS

JUNCTION: PARTIAL FILL CAVITY WALL/PARTY WALL PLAN DETAIL

TO BE READ IN CONJUNCTION WITH Y-VALUE CALCULATION

thermal
Liteblock

Roadstone Custom Psi values		
U Value Range (W/m ² K)	Part L (Ψ)	Roadstone TLB Psi (Ψ) Value
0.21	0.045	0.042

As modelled by NSAI registered Thermal Modellers:

 NSAI Agreement	 NSAI Agreement
---	---

<p>Diarmuid Hynes Evolution Innovation ltd. Registration Number IAB/TM/04 NSAI Approved Thermal Modeller</p>	<p>Andrew Dunne Evolution Innovation ltd. Registration Number IAB/TM/07 NSAI Approved Thermal Modeller</p>
---	---

All options pass FRsi assessment, no surface condensation predicted

*Note:

In the 0.21 U_{wall} Range the model surpasses the default Psi value and therefore a y-value of 0.08 can be assumed using this option without a y-value calculation, provided all other details in the building comply with the published ACDS and/or Roadstone modelled details.

